


Two Boilers cascaded with two domestic tanks

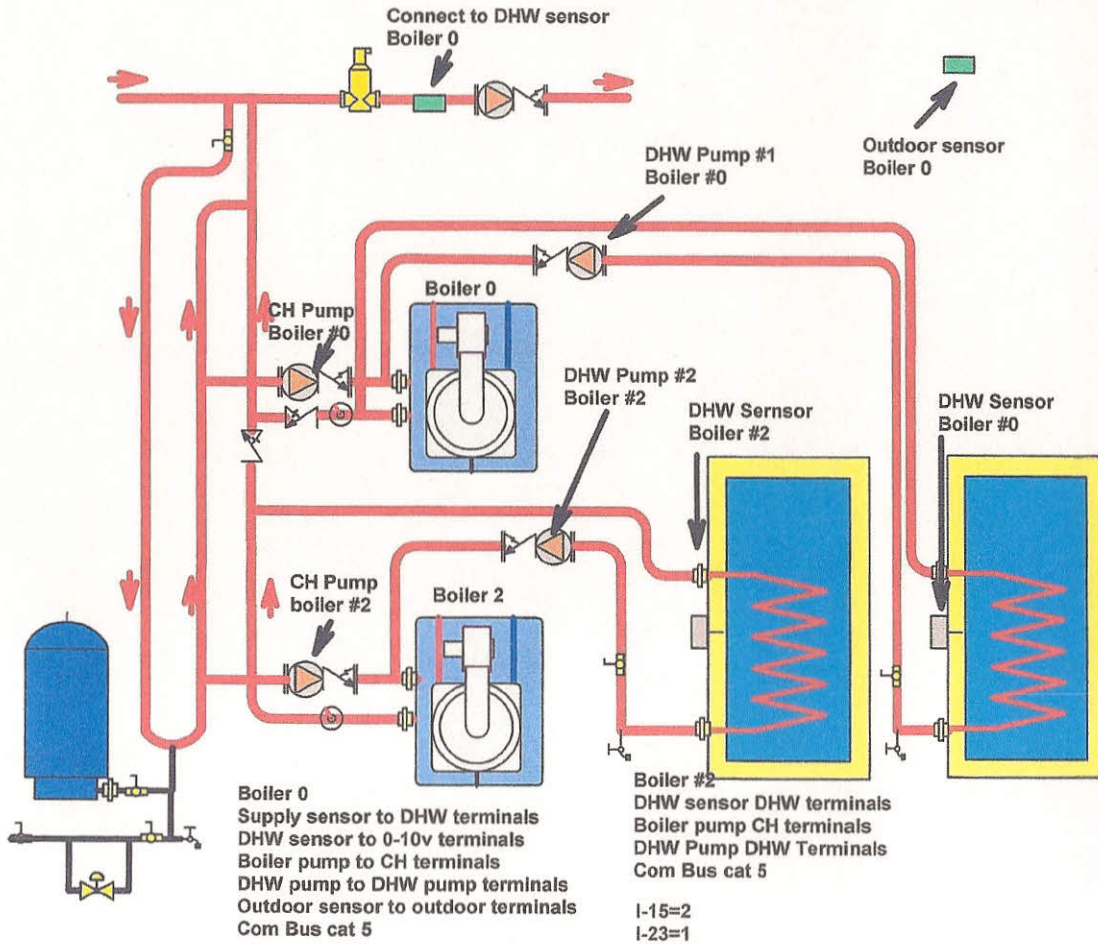

Boiler 0
 Supply sensor to DHW terminals
 DHW sensor to 0-10v terminals
 Boiler pump to CH terminals
 DHW pump to DHW pump terminals
 Outdoor sensor to outdoor terminals
 Com Bus cat 5

I-15=0
 I-23=1 (all 926)
 I-16=3 DHW sensor)
 I 25=1 (central heat)

Boiler #2
 DHW sensor DHW terminals
 Boiler pump CH terminals
 DHW Pump DHW Terminals
 Com Bus cat 5

I-15=2
 I-23=1

Notes

If both boilers are being called for DHW
 There will be none available for central heating

CH temp is determined by outdoor sensor
 DHW boiler temp is controlled by I-19